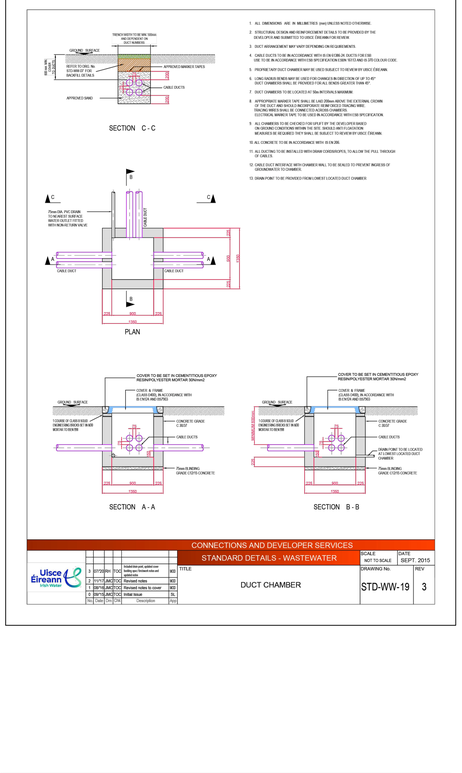

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: SEPT. 2015
TITLE: DUCT CHAMBER
DRAWING No.: STD-WW-19 | REV: 3

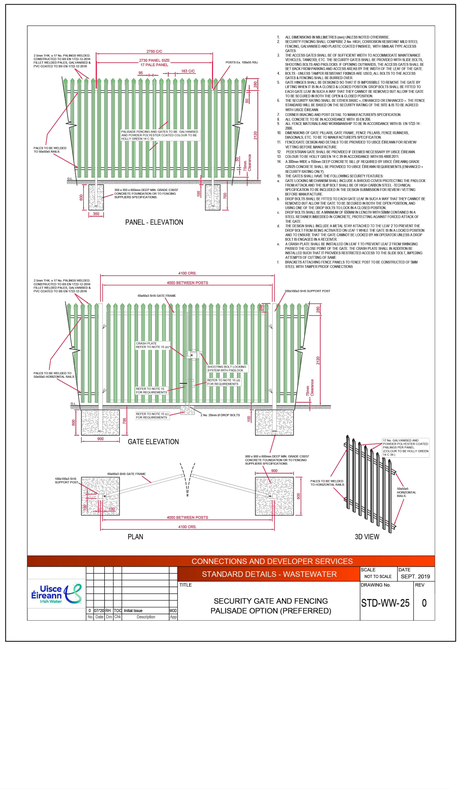

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: SEPT. 2019
TITLE: SECURITY GATE AND FENCING PALISADE OPTION (PREFERRED)
DRAWING No.: STD-WW-25 | REV: 0

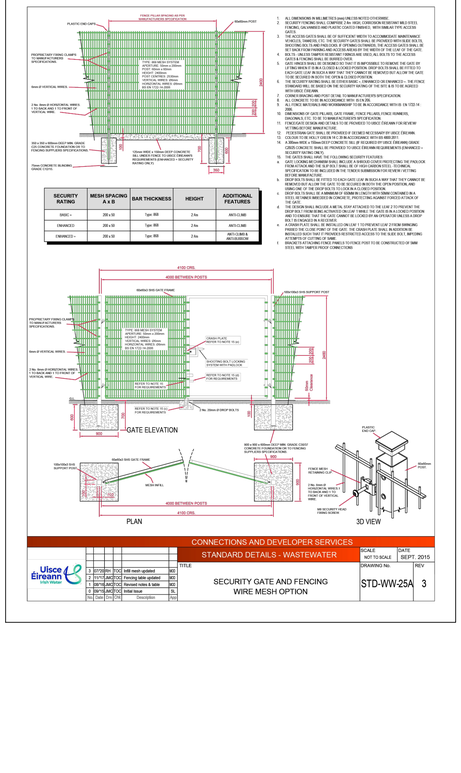

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: SEPT. 2015
TITLE: SECURITY GATE AND FENCING WIRE MESH OPTION
DRAWING No.: STD-WW-25A | REV: 3

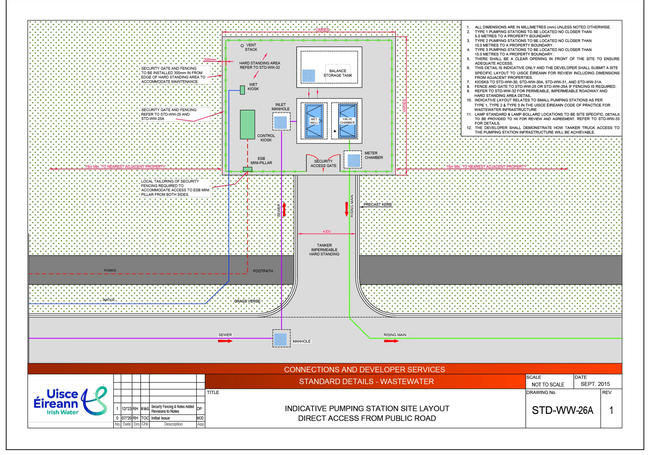

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: SEPT. 2019
TITLE: TYPE 1 PUMPING STATION CONTROL KIOSK
DRAWING No.: STD-WW- 30 | REV: 4

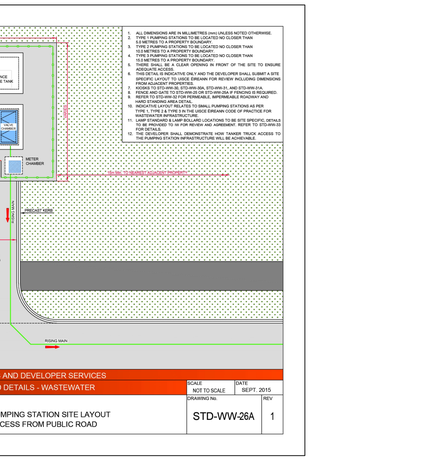

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: SEPT. 2015
TITLE: PUMPING STATION WET KIOSK
DRAWING No.: STD-WW-31 | REV: 4

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: SEPT. 2015
TITLE: FLOW METER & VALVE CHAMBER (FOUL RISING MAIN ≤200mm DIA.) PRECAST CONCRETE OPTION
DRAWING No.: STD-WW-27A | REV: 1

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: JUL. 2016
TITLE: INDICATIVE PRE-CAST CONCRETE SUBMERSIBLE PUMPING STATION WITH CAST IN-SITU VALVE CHAMBER
DRAWING No.: STD-WW-28A | REV: 3

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: SEPT. 2015
TITLE: RISING MAIN DISCHARGE STAND OFF MANHOLE
DRAWING No.: STD-WW-29 | REV: 4

CONNECTIONS AND DEVELOPER SERVICES
STANDARD DETAILS - WASTEWATER
SCALE: NOT TO SCALE | DATE: SEPT. 2015
TITLE: PUMPING STATION WET KIOSK
DRAWING No.: STD-WW-31 | REV: 4

© PUNCH Consulting Engineers
This drawing and any design hereon is the copyright of the Consultants and must not be reproduced without their written consent. All drawings remain the property of the Consultants. Figured dimension only to be taken from this drawing. Consultants to be informed immediately of any discrepancies before work proceeds.
COLOUR DRAWING
ISO 9001 QUALITY MANAGEMENT
ISO 14001 ENVIRONMENTAL MANAGEMENT
ISO 45001 HEALTH & SAFETY MANAGEMENT
BUILDING INFORMATION MODELLING (BIM) I.S. EN ISO 19650-2:2018
NSAI Certified

Rev	Date	By	Amendment
C01	2026-05-15	SK	ISSUED FOR PLANNING

Rev	Date	By	Amendment

Client:

PUNCH CONSULTING ENGINEERS
Dublin | Limerick | Cork | Galway | Glasgow | Macclesfield
97 Henry Street, Limerick, V94 YC2H, Ireland
t. +353 61 221 200 | w. punchconsulting.com

Project:	PARKWAY VALLEY LRD
Title:	DRAINAGE DETAILS SHEET 3
Drawn: C Buckley	Date drawn: 2025-10-09
Technician Check: PJ Mulcahy	Engineer Check: Tracey O Connell
Approved: Julie Tiernan	
Project No.: 231171	Model Ref.: 231171-PUNCH-XX-XX-M2-C-0503
Drawing Status: AO (Planning)	
Scale @ A1: As Shown	Document No.: 231171-PUNCH-XX-XX-DR-C-0503
Revision No: C01	